


SOUTH TARANAKI DISTRICT COUNCIL
AMENDED PLANS

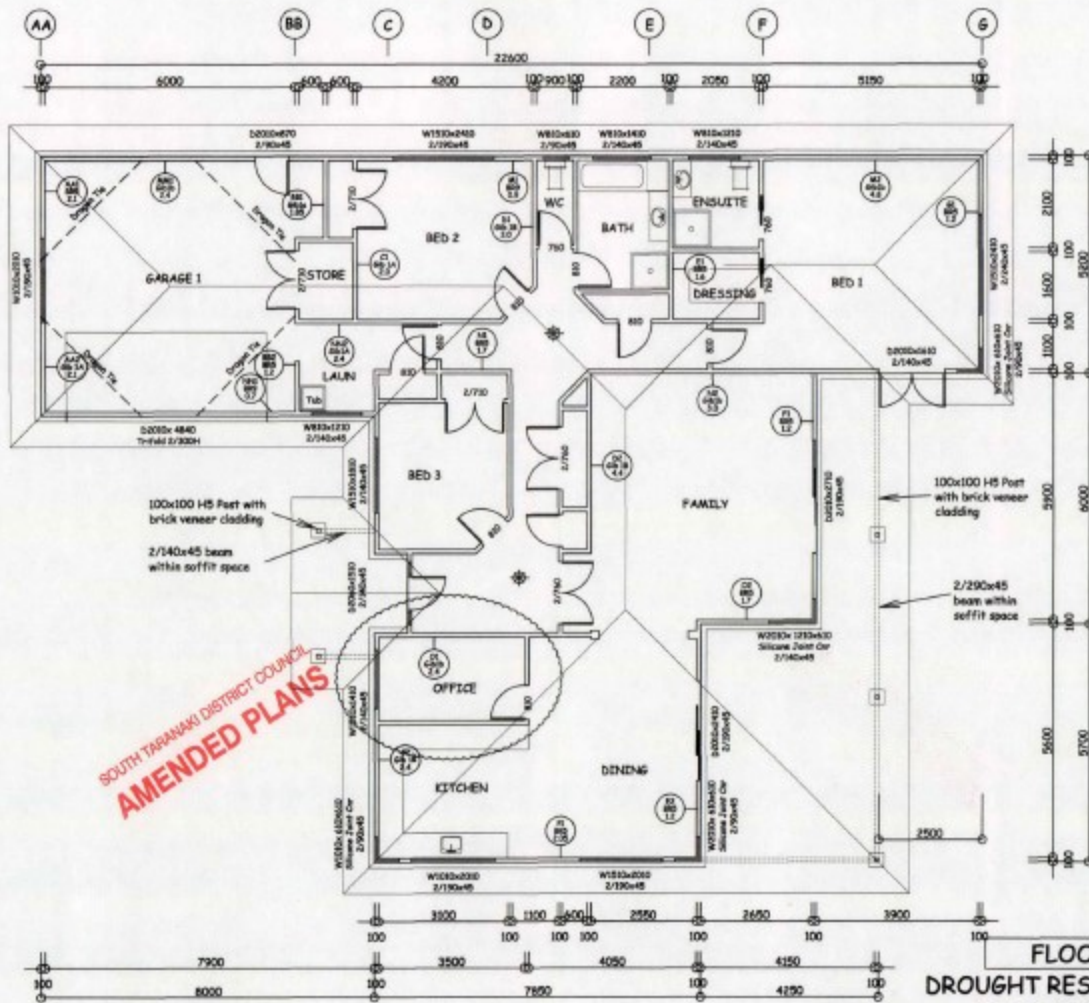

NOTE
The bracing types as scheduled shall be fixed as specified in the Wirecrete Wallboards Ltd Gb-board Bracing System Manual dated August 1999 and the Construction Plywood Bracing System Manual dated April 1992.

AREA - 232.3m²
(over wall framing)
242.7m² (over brick)

ROOF - 30 deg pitch
750mm Overhang

• Ceiling mounted battery operated smoke detectors

Note:
A smoke detector must be fitted within 3m of all bedroom doorways.
(2nos. fitted to house)

It is the contractor's responsibility to verify all dimensions on site.
All work is to comply with the acceptable solutions of the New Zealand Building Code. All work to comply with NZS 3604: 1999

FLOOR PLAN
DROUGHT RESIDENCE
Lot 2 of DP334063

File ref	
DATE	8/3/05
SCALE	1 : 100
DRAWING NUMBER	
SHEET	REV A

Revisions:
REV A 8/3/05

